


Model BC-75CR

INSTALLATION DETAILS

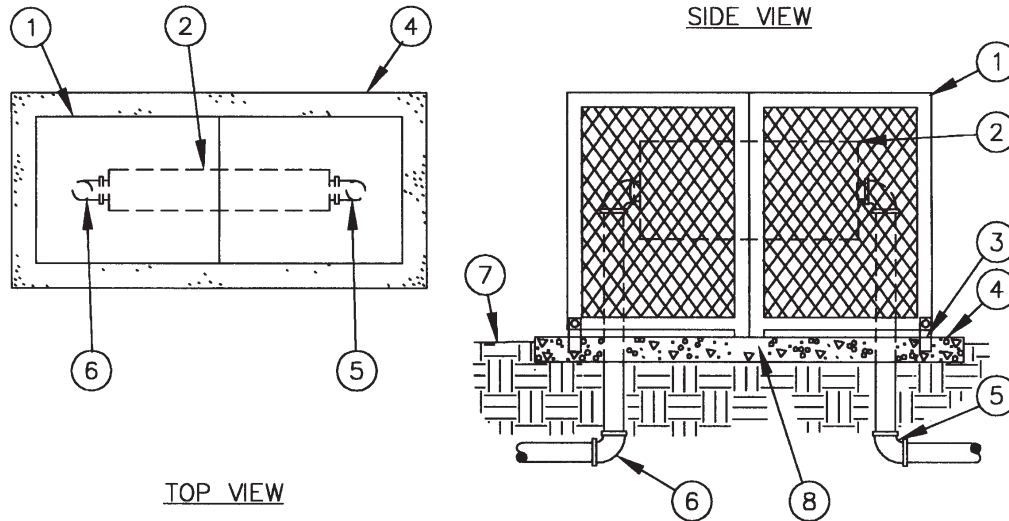

- | | |
|---|------------------------------|
| 1. Expanded Metal Backflow Enclosure | 5. Water Service Inlet Pipe |
| 2. Backflow Preventer | 6. Water Service Outlet Pipe |
| 3. Anchor Rod (typical) | 7. Finish Grade |
| 4. Poured Concrete Base – 6” minimum thickness – extend 4” beyond outside dimensions of enclosure | |

SPECIFICATIONS

The backflow cover shall be of a vandal resistant nature manufactured of formed and expanded metal, coated with a performance polymer alloy coating to prevent handling injury. The cover shall be in two sections with a hinge on each end and a locking tab at the center. The hinges shall be attached to mounting brackets with carriage bolts to allow

removal of the cover from the hinges. The mounting brackets shall be submerged into the concrete a minimum of two inches, positioning the cover one and one half inches above the concrete. The locking tab shall accept a padlock. Handles shall be attached to the sides to facilitate raising and lowering of the cover.